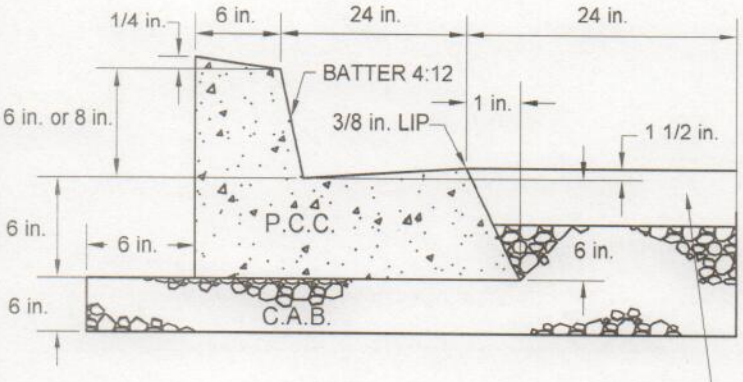

C-1

EXIST. THICKNESS + 1 in.
3 in. MIN. C2 PG 64-10
ASPHALT CONCRETE

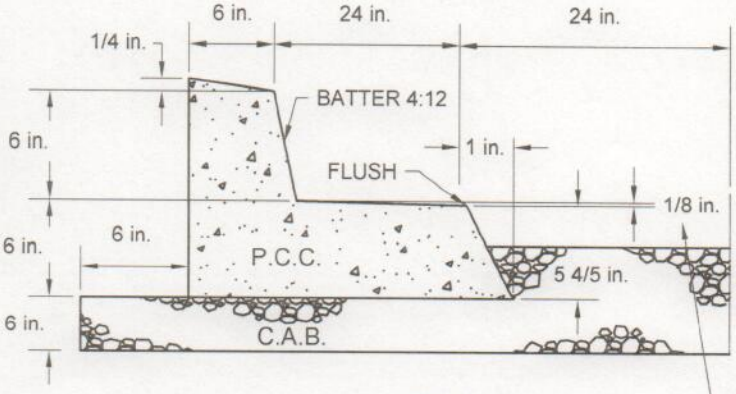

C-3

EXIST. THICKNESS + 1 in.
3 in. MIN. C2 PG 64-10
ASPHALT CONCRETE

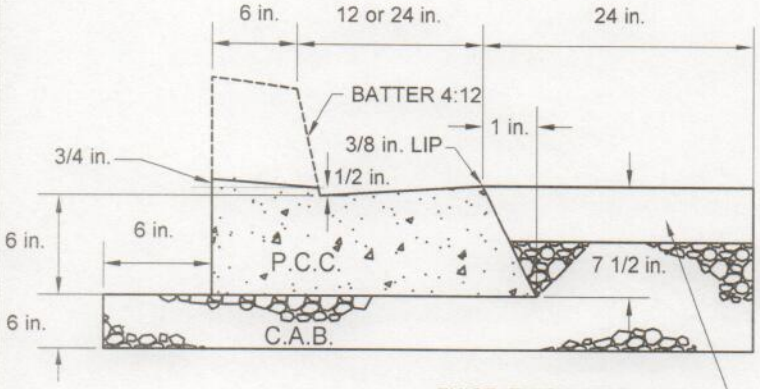

C-2

EXIST. THICKNESS + 1 in.
3 in. MIN. C2 PG 64-10
ASPHALT CONCRETE

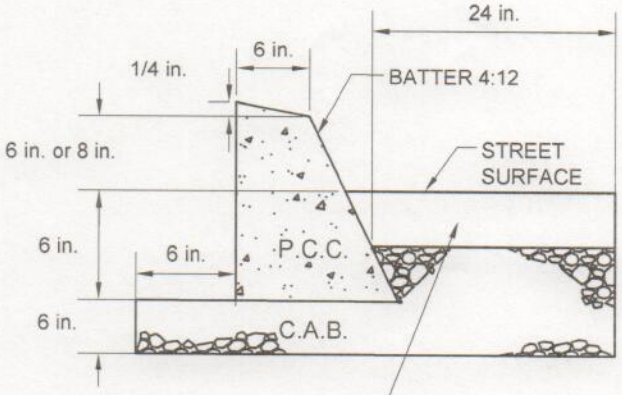

C-4

EXIST. THICKNESS + 1 in.
3 in. MIN. PG 64-10
ASPHALT CONCRETE

NOTES:

1. 1/2 IN. EXPANSION JOINTS SHALL BE PLACED EVERY 60 FT. WEAKENED PLANE JOINTS PLACED EVERY 20 FT.
2. BASE SHALL BE CRUSHED AGGREGATE BASE PER THE "STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION" LATEST EDITION.
3. PORTLAND CEMENT CONCRETE SHALL BE 520-C-2500 PER "STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION" LATEST EDITION.
4. ALL EXPOSED CORNERS ON P.C.C. CURBS AND GUTTERS TO BE ROUNDED WITH 3/4 IN. RADIUS.
5. ALL ASPHALT CONCRETE AND P.C.C. TO BE REMOVED SHALL BE SAWCUT AT REMOVAL LIMITS. (MIN 5 IN. SAWCUT.)

CITY OF GARDENA	PUBLIC WORKS DEPARTMENT	ENGINEERING DIVISION
TITLE: CURB AND GUTTER	APP. BY: CITY ENGINEER	5/27/2015 DATE
	DESIGNED BY JC 5/6/15	DWG. NO. ST - 7
	DRAWN BY RS 5/6/15	
	CHECKED BY JF 5/6/15	